



Rev.	Date	No.	Description	Dr	Ch	App
Title <b>FRAMNÄS - KOLABACKEN 110 kV</b> <b>Johto- ja kaapelialueen poikkileikkaus</b>				Designer/date <b>TLT-B</b>		Drawn by/date <b>PKO 4.7.2022</b>
				TLT-BUILDING OY Puunaulakatu 13 28100 PORI www.tltgroup.fi		Checked by/date
				Approved by/date		
Scale	Level	Size <b>A4</b>	Sheet/Sheets 1(4)	Document code		Revision <b>MO</b>

CARUNA ESPOO OY FORTUM POWER AND HEAT OY  
 110 kV 110 kV  
 FRAMNÄS - FRAMNÄS -  
 MASALA KOLABACKEN  
 SUTU 1244

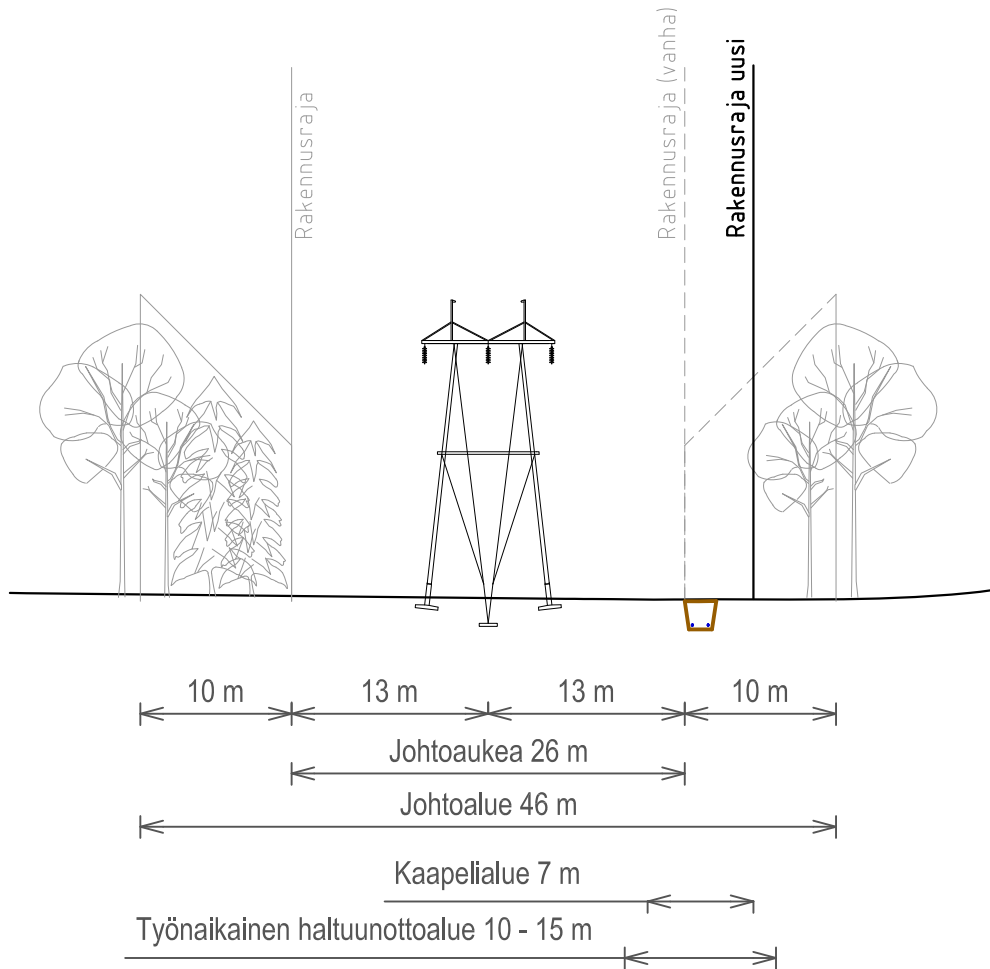

Rev.	Date	No.	Description	Dr	Ch	App
Title <b>FRAMNÄS - KOLABACKEN 110 kV</b> <b>Johto ja - kaapelialueen poikkileikkaus</b>				Designer/date <b>TLT-B</b> Drawn by/date <b>PKO 4.7.2022</b> Checked by/date Approved by/date		TLT-BUILDING OY Puunaulakatu 13 28100 PORI www.tltgroup.fi
Scale	Level	Size <b>A4</b>	Sheet/Sheets <b>2(4)</b>	Document code		Revision <b>MO</b>

FORTUM POWER AND HEAT OY CARUNA ESPOO OY  
 110 kV 110 kV  
 FRAMNÄS - KOLABACKEN FRAMNÄS -  
 MASALA  
 SUTU 1244

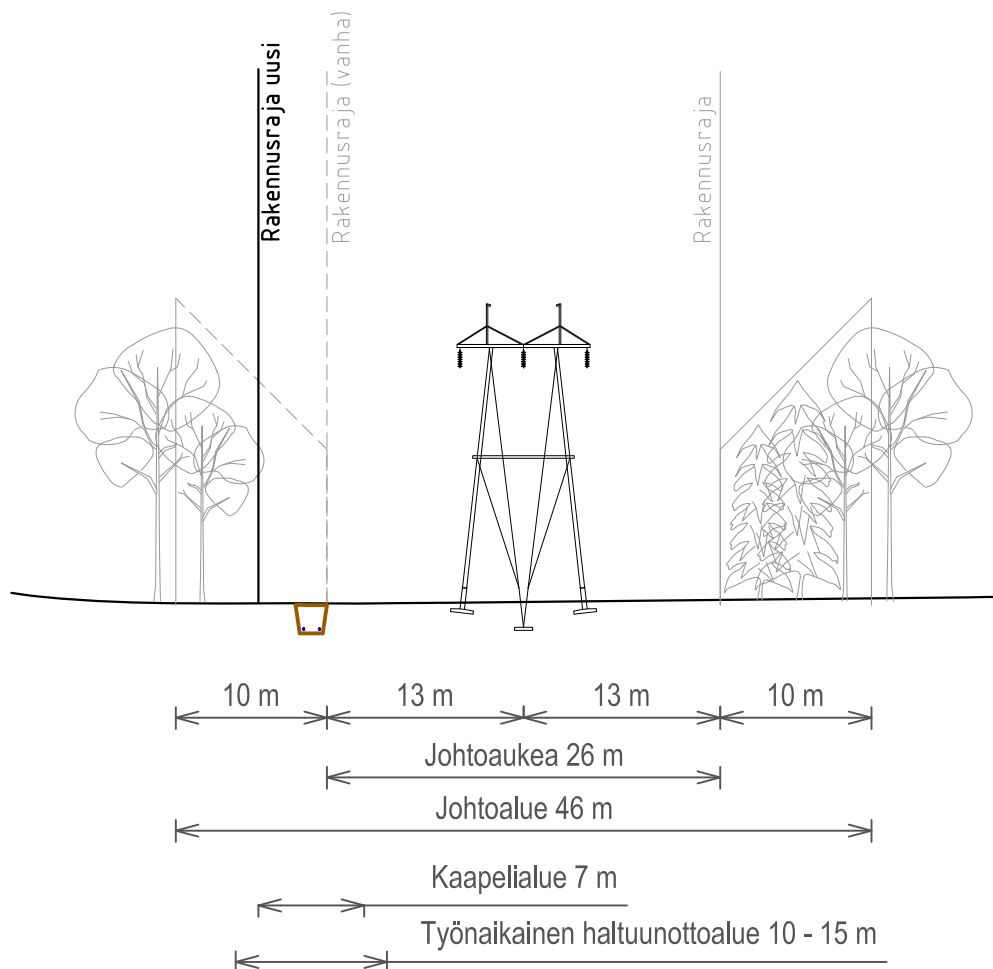


Rev.	Date	No.	Description	Dr	Ch	App
Title <b>FRAMNÄS - KOLABACKEN 110 kV</b> <b>Johto ja - kaapelialueen poikkileikkaus</b>				Designer/date <b>TLT-B</b>		Drawn by/date <b>PKO 4.7.2022</b>
				TLT-BUILDING OY Puunaulakatu 13 28100 PORI www.tltgroup.fi		Checked by/date
				Approved by/date		
Scale	Level	Size <b>A4</b>	Sheet/Sheets <b>3(4)</b>	Document code		Revision <b>MO</b>

FORTUM POWER AND HEAT OY  
110 kV  
FRAMNÄS -  
KOLABACKEN

Rakennusraja

Rakennusraja

n. 1,35 m  
Kaivannon syvyys

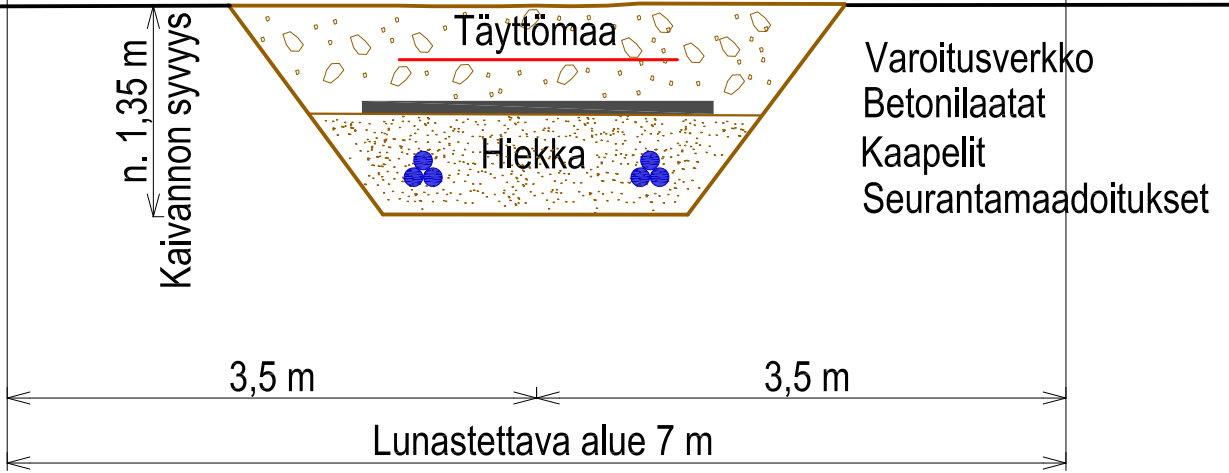

3,5 m

3,5 m

Lunastettava alue 7 m

Työnaikainen haltuunottoalue 10-15 m

Rev.	Date	No.	Description	Dr	Ch	App
Title <b>FRAMNÄS - KOLABACKEN 110 kV</b> <b>Kaapelialueen poikkileikkaus</b>				Designer/date <b>TLT-B</b>		Drawn by/date <b>PKO 4.7.2022</b>
				TLT-BUILDING OY Puunaulakatu 13 28100 PORI www.tltgroup.fi		Checked by/date
						Approved by/date
Scale	Level	Size <b>A4</b>	Sheet/Sheets <b>4(4)</b>	Document code		Revision <b>M0</b>